Installation Instruction



Product Code: GBSR2NMWH

Product Description: IP65 LED Surface

Emergency Down Light











Specification

Emergency Power: 2.2W EM Duration: 3 hours Ambient Temp: 5-45°C

Emergency Mode: Non-Maintained Function: Standard/Self Test LiFePO4 3.2V 3Ah Battery:

Warranty: 3 years





Installation Date:





Routine Testing

Testing should be carried out in accordance with the recommendations of BS5266 & EN50172.

- 1. Do not switch off unswitched mains supply after installation. If interruption is unavoidable, the batteries must be disconnected or damage to the batteries may occur. Leave the luminaire on continuous charge for 24 hours.
- 2. A monthly functional test should be conducted manually.
- 3. Annually, a full three hour duration test should be conducted manually.
- 4. Batteries should be replaced when the luminaire no longer meets the 3 hours duration performance.
- 5. Testing is performed by interrupting the unswitched supply for the test duration manually or self-test function complying with IEC62034.

During testing the luminaire should remain illuminated in emergency mode.

Location:

- 6. Ensure that the 'charge indicator' is 'ON' during 'Charging Mode'.
- If the charge indicator (LED) is unlit, this signifies a fault. 7. Replace faulty light source and batteries immediately.

To assist with this testing, a test record is included below.

To increase the chance of a fault being reported between monthly tests, it is desirable that staff are made aware of the purpose of the indicator.


Testing Record

Product:

11 12

Functional/Duration Year 3 Month Year 1 Year 2 Year 4 Year 5 3 4 5 6 7 R 9 10

Installation Instruction

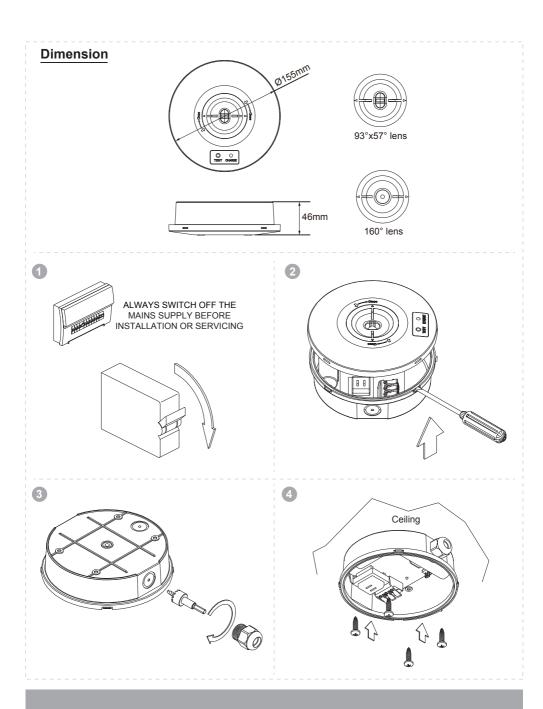

Installation Instruction

