

TYPE A RCD FUSED CONNECTION UNITS

White	Metal Clad
M92W	M92M

SAFETYSURE

PRO SERIES by **GREEN BROOK**

IMPORTANT - For your protection

This product should be installed by a competent person and in accordance with the current IET Wiring Regulations. If in doubt, consult a qualified electrician.

Electricity is dangerous and an RCD must not be used as a substitute for normal precautionary measures. Always disconnect from mains supply before any inspection or repair to equipment is carried out. Do not allow children to tamper with electrical devices.

This device will protect against live and neutral leakage faults to earth, it will not protect against electric shock due to contact with both conductors, short circuits between live and neutral, or a fault in the wiring supply to this device.

Should your SafetySure RCD Fused Connection Unit, trip when first powered, repeatedly trip with an appliance connected or fail to trip when tested in accordance with the instructions, **Do Not Use**, please consult a qualified Electrician.

Type A RCDs are suitable for use with single phase supplies and applications with electronic components.

Type AC RCD should not be fitted upstream of a Type A RCD as the load characteristics of a Type A RCD could then impair operation of the Type AC RCD.


This product should be fitted with a BS1362 fuse in accordance with equipment manufacturers' specification.

IMPORTANT:

When using the front plate cable entry the plastic cut out must be removed with care.

TO FIT THIS SAFETYSURE RCD FUSED CONNECTION UNIT -

Switch off the power supply at the mains in order to isolate the existing spur. Remove the old spur, then simply connect using the easy to follow wiring diagram.

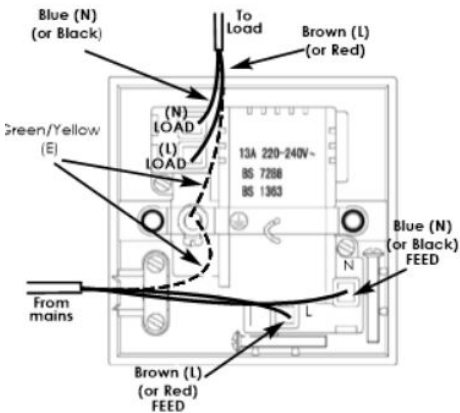

If earth conductors are bare, they must be sleeved with appropriate green/yellow sleeving.

If you are in any doubt about connecting this product consult a qualified electrician.

Wiring insulation tests should be completed before setting the SafetySure RCD fused connection unit to avoid misleading instrument readings and possible internal damage to the unit.

PLEASE CARRY OUT THIS SIMPLE TEST PROCEDURE PRIOR TO EACH USE.

1. Press green(R) reset button.
 2. Indicator window will turn red*.
 3. Press white Test button (T).
 4. Red window indicator will disappear*. This means the RCD has tripped successfully.
 5. To reset – press green (R) button.
- * If indicator fails to work, do not use and return to place of purchase.

NOTE 1:

If the red window indicator disappears once the unit has been reset, this may mean that the appliance or the cable lead is faulty, and should be checked by a qualified electrician.

NOTE 2:

Remove this RCD from circuit before performing any high voltage insulation tests.

TECHNICAL INFORMATION

Rated voltage:	230V AC 50Hz
IP Rating:	IP20
Maximum operating current:	Resistive Load: 13A Inductive Load: 13A
Rated trip current:	30mA
Trip speed:	30mS Typical
RCD contact break:	Double pole
Rated Short-circuit breaking and making Capacity:	250A
Rated conditional short-circuit current:	1500A Power factor range .93 to .98
Terminal Capacities:	Upto 3 x 1.5mm ² / 3 x 2.5mm ²
Dimensions:	86.5mm x 86.5mm x 48mm
Conforms to:	BS7288:2016+A1:2022 & BS1363-4:2023

Single Gang RCD Fused Connection Unit has been designed for storage and use between -5°C and +40°C, and at an altitude of no greater than 2000m above sea level. Care must be taken not to subject the unit to misuse, such as abnormal pollution by smoke, chemical or flammable fumes, salt laden spray, prolonged periods of high humidity or other abnormal conditions.

NOTE:

Product & Packaging Disposal

When disposing of this item and its packaging please follow local regulations and use an appropriate waste disposal centre.
See GreenBrook website for further details.

GUARANTEE

Your SafetySure RCD fused connection unit is guaranteed for 1 year from the date of purchase.
This is in addition to your statutory rights.

PLEASE KEEP THESE INSTRUCTIONS SAFE FOR FUTURE REFERENCE